



# IECEX Certificate of Conformity

## INTERNATIONAL ELECTROTECHNICAL COMMISSION IEC Certification System for Explosive Atmospheres

for rules and details of the IECEx Scheme visit [www.iecex.com](http://www.iecex.com)

Certificate No.:	<b>IECEX EXA 16.0006X</b>	Page 1 of 4	<u>Certificate history:</u>
Status:	<b>Current</b>	Issue No: 2	<a href="#">Issue 1 (2018-02-26)</a> <a href="#">Issue 0 (2016-03-10)</a>
Date of Issue:	2025-02-21		
Applicant:	<b>CEMP Srl</b> via Piemonte 16 I-20030 Senago (MI) <b>Italy</b>		
Equipment:	<b>Three-phase and single phase motors, brake motors supplied by mains or inverter</b>		
Optional accessory:	AC/AB...r... ; DC/HC...r ... ; size 63 – 315 and AM 315 L and AC 315 L		
Type of Protection:	<b>'d'; 'e'; 'tb/tc'</b>		
Marking:	Ex db IIC/IIB T6...T3 Gb or Ex db eb IIC/IIB T6...T3 Gb and/or Ex tb/tc IIIC/IIIB T85°C...T150°C Db Ex db I Mb or Ex db eb I Mb (only for size 315 L)		

Approved for issue on behalf of the IECEx  
Certification Body:

**Marino Kelava**

Position:

**Certification Signatory**

Signature:  
(for printed version)

Date:  
(for printed version)

1. This certificate and schedule may only be reproduced in full.
2. This certificate is not transferable and remains the property of the issuing body.
3. The Status and authenticity of this certificate may be verified by visiting [www.iecex.com](http://www.iecex.com) or use of this QR Code.



Certificate issued by:

**Fiditas Ltd**  
**Slavka Tomerlina 44**  
**HR-10361 Zagreb-Sesvete**  
**Croatia**



**Fiditas**  
explosion safety solutions



# IECEX Certificate of Conformity

Certificate No.: **IECEX EXA 16.0006X**

Page 2 of 4

Date of issue: 2025-02-21

Issue No: 2

Manufacturer: **CEMP Srl**  
via Piemonte 16  
I-20030 Senago (MI)  
**Italy**

Manufacturing  
locations:

This certificate is issued as verification that a sample(s), representative of production, was assessed and tested and found to comply with the IEC Standard list below and that the manufacturer's quality system, relating to the Ex products covered by this certificate, was assessed and found to comply with the IECEX Quality system requirements. This certificate is granted subject to the conditions as set out in IECEX Scheme Rules, IECEX 02 and Operational Documents as amended

## STANDARDS :

The equipment and any acceptable variations to it specified in the schedule of this certificate and the identified documents, was found to comply with the following standards

[IEC 60079-0:2017](#) Explosive atmospheres - Part 0: Equipment - General requirements  
Edition:7.0

[IEC 60079-1:2014](#) Explosive atmospheres - Part 1: Equipment protection by flameproof enclosures "d"  
Edition:7.0

[IEC 60079-31:2022](#) Explosive atmospheres – Part 31: Equipment dust ignition protection by enclosure "t"  
Edition:3.0

[IEC 60079-7:2017](#) Explosive atmospheres - Part 7: Equipment protection by increased safety "e"  
Edition:5.1

This Certificate **does not** indicate compliance with safety and performance requirements other than those expressly included in the Standards listed above.

## TEST & ASSESSMENT REPORTS:

A sample(s) of the equipment listed has successfully met the examination and test requirements as recorded in:

Test Reports:

[HR/EXA/ExTR14.0008/00](#)  
[HR/EXA/ExTR14.0008/03](#)

[HR/EXA/ExTR14.0008/01](#)  
[HR/EXA/ExTR14.0008/04](#)

[HR/EXA/ExTR14.0008/02](#)  
[IT/CES/ExTR14.0028/00](#)

Quality Assessment Report:

[IT/CES/QAR07.0002/19](#)



# IECEx Certificate of Conformity

Certificate No.: **IECEx EXA 16.0006X**

Page 3 of 4

Date of issue: 2025-02-21

Issue No: 2

## EQUIPMENT:

Equipment and systems covered by this Certificate are as follows:

The three-phase and single phase asynchronous motors series AC/AB...r... sizes 63-71-80-90-100, 112-132-160; 180-200-225-250; 280-315; 315L and serie AM 315L are made of cast iron with separate compartments: motor enclosure and terminal box for supply and auxiliary circuits connection. Motor enclosure is designed in Ex d type of protection, while terminal box can be Ex d or Ex e type of protection.

The motor enclosure satisfies also Ex tb type of protection, mechanical protection IP65 or IP64. The motors can be equipped with auxiliary devices: heaters, thermal detectors, encoders etc.

The flamepaths are specified in the manufacturing drawings. For information regarding the dimensions of the flameproof joints the manufacturer shall be contacted.

Additional Information given in the Annex.

## SPECIFIC CONDITIONS OF USE: YES as shown below:

- The flame paths are specified on the manufacturer's drawings. For information regarding the dimensions of the flameproof joints the manufacturer shall be contacted.
- In special cases the suitable paint system is not in compliance to thickness limit indicated for gas group IIC. In order to minimize risk of hazards caused by electrostatic charges, clean motor only with a wet rag or by non-frictional means.
- For the installation in places with presence of dust shall be taken into account the risk of electrostatic charges able to activate propagating brush discharges.
- For installation in places with presence of dust group IIIC, when the motors are made without flange, the D-end sealing ring shall be protected from light by a device supplied by the manufacturer.
- For use with non-sinusoidal or variable frequency supplies the motor is fitted with thermal protection in the form of one PTC or PT100 thermal probe per phase in the drive end stator winding overhang. These are to be connected to a protection circuit so as to limit the stator temperature to:
  - max. 120°C for temperature class T4/T125°C
  - max. 130°C for T4/T135°C and for group I
  - max. 140°C for T3/T150°C.
- The cable temperature in motors (temperature class T4 or T3) at the entry point is greater than 70 °C, and at the branching point is greater than 80°C, therefore connection for those motors shall be provided with cable of thermal stability not less than 90°C.
- The motor when provided with the cables permanently connected shall have these cables protected against the risk of damage due to mechanical stresses. The end connections shall be made according to one of the types of protection indicated in the IEC 60079-0 standard and in accordance with the installation rules in force in the site of installation.



# IECEX Certificate of Conformity

Certificate No.: **IECEX EXA 16.0006X**

Page 4 of 4

Date of issue: 2025-02-21

Issue No: 2

**DETAILS OF CERTIFICATE CHANGES (for issues 1 and above)**

Update to new issue: IEC 60079-0:2017; IEC 60079-1:2014; IEC 60079-7:2017 and IEC 60079-31:2022

List of Ex equipment and Ex components has been updated.

**Annex:**

[IECEX EXA16.0006 CEMP motor Annex1-issue2.pdf](#)

## Technical description (continued from original certificate)

The three-phase asynchronous motors with brakes series DC/HC...r... , DB/HB...r... sizes 63-71-80-90-100, 112-132-160; 180-200-225-250; 280-315; 315L and AM 315L are made of cast iron with separate compartments: motor enclosure and terminal box for supply and auxiliary circuits connection. Motor enclosure is designed in Ex d type of protection, while terminal box can be Ex d or Ex e type of protection. The motor enclosure satisfies also Ex tb type of protection, mechanical protection IP65 or IP64. The electromechanical brake device is located on the flame-proof enclosure with Ex d type of protection. Brake main components are: an electromagnet, a mobile anchor held by three studs on which it able to slide, and brake disc able to move the axis of toothed hub connected to the motor shaft. Brake disc frictional material can work at temperature up to 160 °C, but is used up to maximum temperature of 100 °C. The brakes sizes up to 160 are without manual hand release and the brakes size 180 - 315 can be with or without manual hand release.

The motors can be equipped with auxiliary devices: heaters, thermal detectors, encoders etc. The anticondensation heaters installed inside the motor enclosure have maximum power of 200 W and are allowed to be in operation only when motor is not powered.

The motor supplied by inverter is equipped inside of stator winding and on bearings with PTC or PT100 thermal detectors for temperature control. Rating data are specified on supplementary plate. The presence of the thermal detectors inside the motor is shown by appropriate warning label. The PTC thermal detectors are calibrated for an operation of:

- max. 120°C for temperature class T4/T125°C
- max. 130°C for T4/T135°C and for group I
- max. 140°C for T3/T150°C.

The motors marked for temperature class T5 and T6 are not intended for supply by inverter.


According to IEC 60034-6 standard, the cooling is achieved by one of the following methods:

- Self-cooled motor by metal fan fitted on shaft, IC 411
- Fan directly coupled, IC 418
- Totally enclosed not ventilated, IC 410
- Forced ventilation by means of auxiliary motor, IC 416 (allowed only for group IIB and IIC)

The motors in type of protection Ex d can be equipped with separately certified draining devices. Motor enclosure sizes 80, 90, 100, 112, 132, 160, 180, 200, 225, 250, 280, 315 and 315L provided with welded sleeve for fixing the drain valve.

The accessories used for cable entry and for unused holes shall be separately certified according to following standards: IEC 60079-1; IEC 60079-7 and IEC 60079-31 as applicable.

## Identification code:

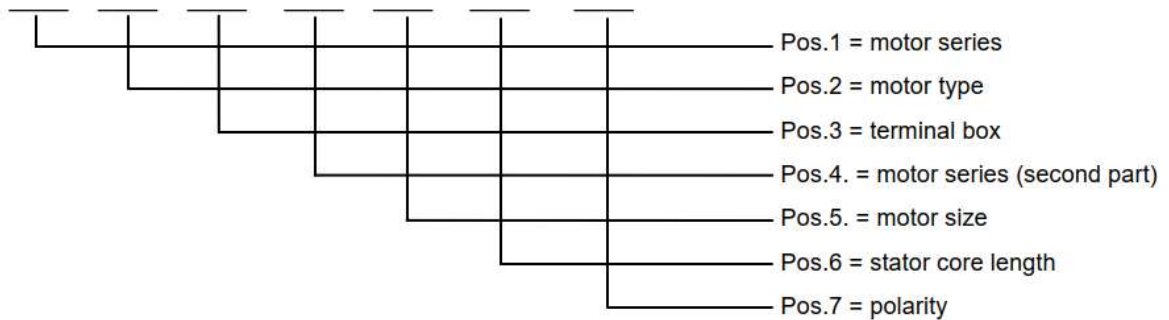

## Explanation of codes:

### Pos.1: Motor series

- **AC** Flameproof electric motors for gas group IIC and for dust group IIIC/IIIB
- **AB** Flameproof electric motors for gas group IIB and for dust group IIIC/IIIB
- **AM** Flameproof electric motors for gas group I (only for size 315L)
- **DC** Flameproof brake motors IC410 for gas group IIC and for dust group IIIC
- **HC** Flameproof brake motors IC411 for gas group IIC and for dust group IIIC
- **DB** Flameproof brake motors IC410 for gas group IIB and for dust group IIIB
- **HB** Flameproof brake motors IC411 for gas group IIB and for dust group IIIB

### Pos. 2: Motor type, electrical features

- **2** Three phase motors double polarity constant torque
- **3** Three phase motors one polarity
- **4** Three phase motors double polarity quadratic torque
- **5** Three phase motors for hoist
- **7** Three phase motors suitable for frequency converter
- **1** Single phase motors (only for AC/AB motors)

### Pos. 3: Terminal box

- **0** Standard terminal box
- **2** With bigger terminal box
- **3** Plate and cable gland version
- **5** Exe terminal box

### Pos. 4: Motor series

- **r** REGAL series

### Pos. 5: Size

- **63** Size 63
- **71** Size 71
- **80** Size 80
- **90** Size 90
- **100** Size 100
- **112** Size 112
- **132** Size 132
- **160** Size 160
- **180** Size 180
- **200** Size 200
- **225** Size 225
- **250** Size 250
- **280** Size 280
- **315** Size 315

## Pos. 6: Stator core length

- **A** Short (63-71-80)
- **B** Long (63-71-80)
- **S** Short (90-225-280-315)
- **L** Long (90-160-180-315)
- **LA** Short (100-160-200)
- **LB** Long (100-160-200)
- **M** Medium (112-180-225-250-280-315)
- **SA** Short (132)
- **SB** Short medium (132)
- **MA** Medium short (160)
- **MB** Medium (132-160)
- **ML** Long (132-225-280)

## Poz. 7: Polarity number

- **2** 2 pole
- **4** 4 pole
- **6** 6 pole
- **8** 8 pole
- **10** 10 pole
- **12** 12 pole
- **16** 16 pole
- **24** Double polarity: 2/4 pole
- **42** Double polarity: 4/24 pole
- **64** Double polarity: 6/24 pole
- **48** Double polarity: 4/8 pole
- **46** Double polarity: 4/6 pole
- **68** Double polarity: 6/8 pole
- **21** Double polarity: 2/12 pole
- **26** Double polarity: 2/6 pole
- **61** Double polarity: 6/12 pole
- **83** Double polarity: 8/16 pole
- **60** Double polarity: 6/10 pole
- **81** Double polarity: 8/12 pole

## Ratings:

### Main supply:

- Maximum rated voltage: 1000 V
- Maximum rated power: 240 kW
- Maximum rated current: 520 A
- Rated frequency: 50 / 60 Hz
- Insulation class: F (with  $\Delta T$  class B)
- Duty: S1, S2, S3, S4, S6, S9
- Max. rated speed: 3600 r.p.m

### Inverter supply:

- Maximum work voltage: 1000 V sizes 63 – 315
- Maximum work voltage: 880 V (Exd) / 800 (Ex de) sizes 315L
- Maximum peak voltage: 2300 V sizes 63 – 315
- Maximum peak voltage: 1250 V sizes 315L
- Frequency range: 5 – 120 Hz sizes 63 – 315
- Frequency range: 5 – 87 Hz
- Max. rated speed: 5200 r.p.m sizes 63 – 100
- Max. rated speed: 4200 r.p.m sizes 112 – 160
- Max. rated speed: 3600 r.p.m sizes 180 – 315 and 315L
- Duty: S9

Certified components/equipment:

Component	Material or Type	IEC Standard Edition	Applicable certificate
Auxiliary terminal board	BARTEC Type 07-9702 / 03	IEC 60079-0:2017 Ed:7.0 IEC 60079-7:2017 Ed:5.1	IECEx EPS 21.0038U
Auxiliary terminal board	CABUR	IEC 60079-0:2011 Ed:6.0 IEC 60079-7:2015 Ed:5.0	IECEx CES 11.0008U
Drain Valve	ECD - CORTEM	IEC 60079-0:2011 Ed:6.0 IEC 60079-1:2014 Ed:7.0 IEC 60079-7:2015 Ed:5.0 IEC 60079-31:2013 Ed:2.0	IECEx CES 14.0016U
Rubber bushing	552 - CEMP	IEC 60079-0:2004 Ed:4.0 IEC 60079-1:2003 Ed:5.0	IECEx LCI 09.0003U
Line bushing	BARTEC Type 07-91...-..../G	IEC 60079-0:2017 Ed:7.0 IEC 60079-1:2014 Ed:7.0	IECEx EPS 13.0045U
Encoder	2REX – SCANCON A/S	IEC 60079-0:2017 Ed:7.0 IEC 60079-1:2014 Ed:7.0 IEC 60079-31:2013 Ed:2.0	IECEx ITS 10.0015X
Encoder	SCANCON Absolute	IEC 60079-0:2017 Ed:7.0 IEC 60079-1:2014 Ed:7.0 IEC 60079-31:2013 Ed:2.0	IECEx ITS 10.0016X
Cable Entry	R and B – RCN Srl	IEC 60079-0:2017 Ed:7.0 IEC 60079-1:2014 Ed:7.0 IEC 60079-31:2013 Ed:2.0 IEC 60079-7:2017 Ed:5.1	IECEx INE 10.0015X

**Rated ambient temperature range**

-50°C to +40°C/+50°C/+60°C only for sizes 63-315 group IIB, IIC or IIIC  
-55°C to +40°C/+50°C/+60°C only for size 315L group IIC or IIIC  
-55°C to +40°C/+50°C/+60°C IIC or IIIC only for size 315L group I  
-50°C to +80°C only for gas group IIB  
-35°C to +60°C only for single phase motor group IIB, IIC or IIIC  
-50°C to +40°C/+50°C/+60°C group IIC or IIB  
For motors sizes 63-71-80-90-100-112-132-160 with brake Tambmin= -20°C  
For motors sizes 180-200-225-250-280-315 with brake Tambmin= -50°C

**Warning markings:**

The following warning markings can be applied to the motors:

- "Restore greasing at every opening"
- "Use screws quality 8.8 ISO 898-1"
- "To energized with cable suitable for temperature 90°C"

In case of use of anticondensation heaters:

- "Warning - energized resistors"



For motors supplied by inverter:

- "Winding protected with PTC thermistors"
- "Winding protected with bimetallic thermistors"
- "Winding protected with PT100 detectors calibrate at 120 °C"
- "Winding protected with PT100 detectors calibrate at 130 °C"
- "Winding protected with PT100 detectors calibrate at 140 °C"

For special painted motors:

- "Warning - Potential electrostatic charging hazard - see instruction"